


FIRE CONNECTION PER LOCAL  
FIRE DEPARTMENT STANDARDS

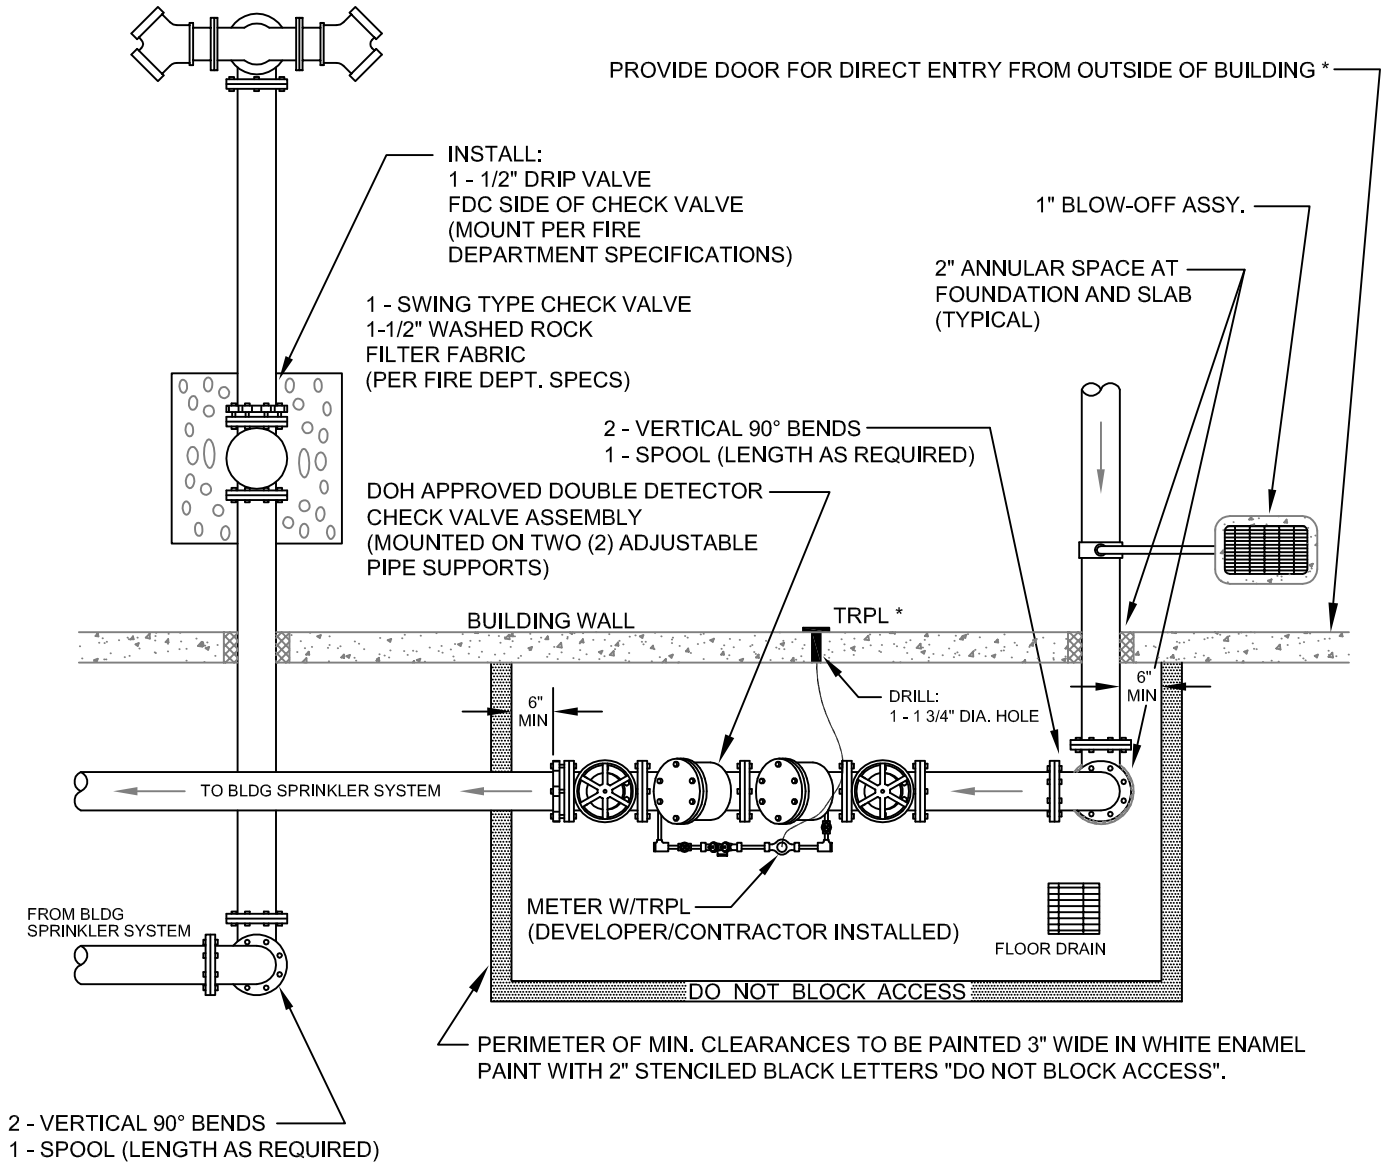

\* NOTES: ALL DDCVA'S SHALL HAVE TOUCH-READ (TRPL) UNITS INSTALLED BY DEVELOPER/CONTRACTOR.  
 INSTALL LOCKING VALVE BOX LID FOR VALVE CONTROLLING SUPPLY LINE TO DDCVA.  
 OUTSIDE ACCESS DOOR TO FIRE DEVICE MUST BE PROVIDED.  
 BYPASS METER SHALL BE 5/8" X 3/4" SENSUS SR-II MODEL WITH ELECTRONIC REGISTER & PLUG-IN CONNECTORS.

**DOUBLE DETECTOR CHECK VALVE ASSY.  
INSIDE BUILDING W / FDC**

NTS



REVISION DATE 10/19/07	DRAWN SED	CHECKED TDK	DISTRICT APPROVED TDK
PLOTTING SCALE NTS	FILE NAME F:\DWGS\DETAILS-2004\HWD-034	DATE APPROVED 10/19/07	