


FIRE CONNECTION PER LOCAL
FIRE DEPARTMENT STANDARDS

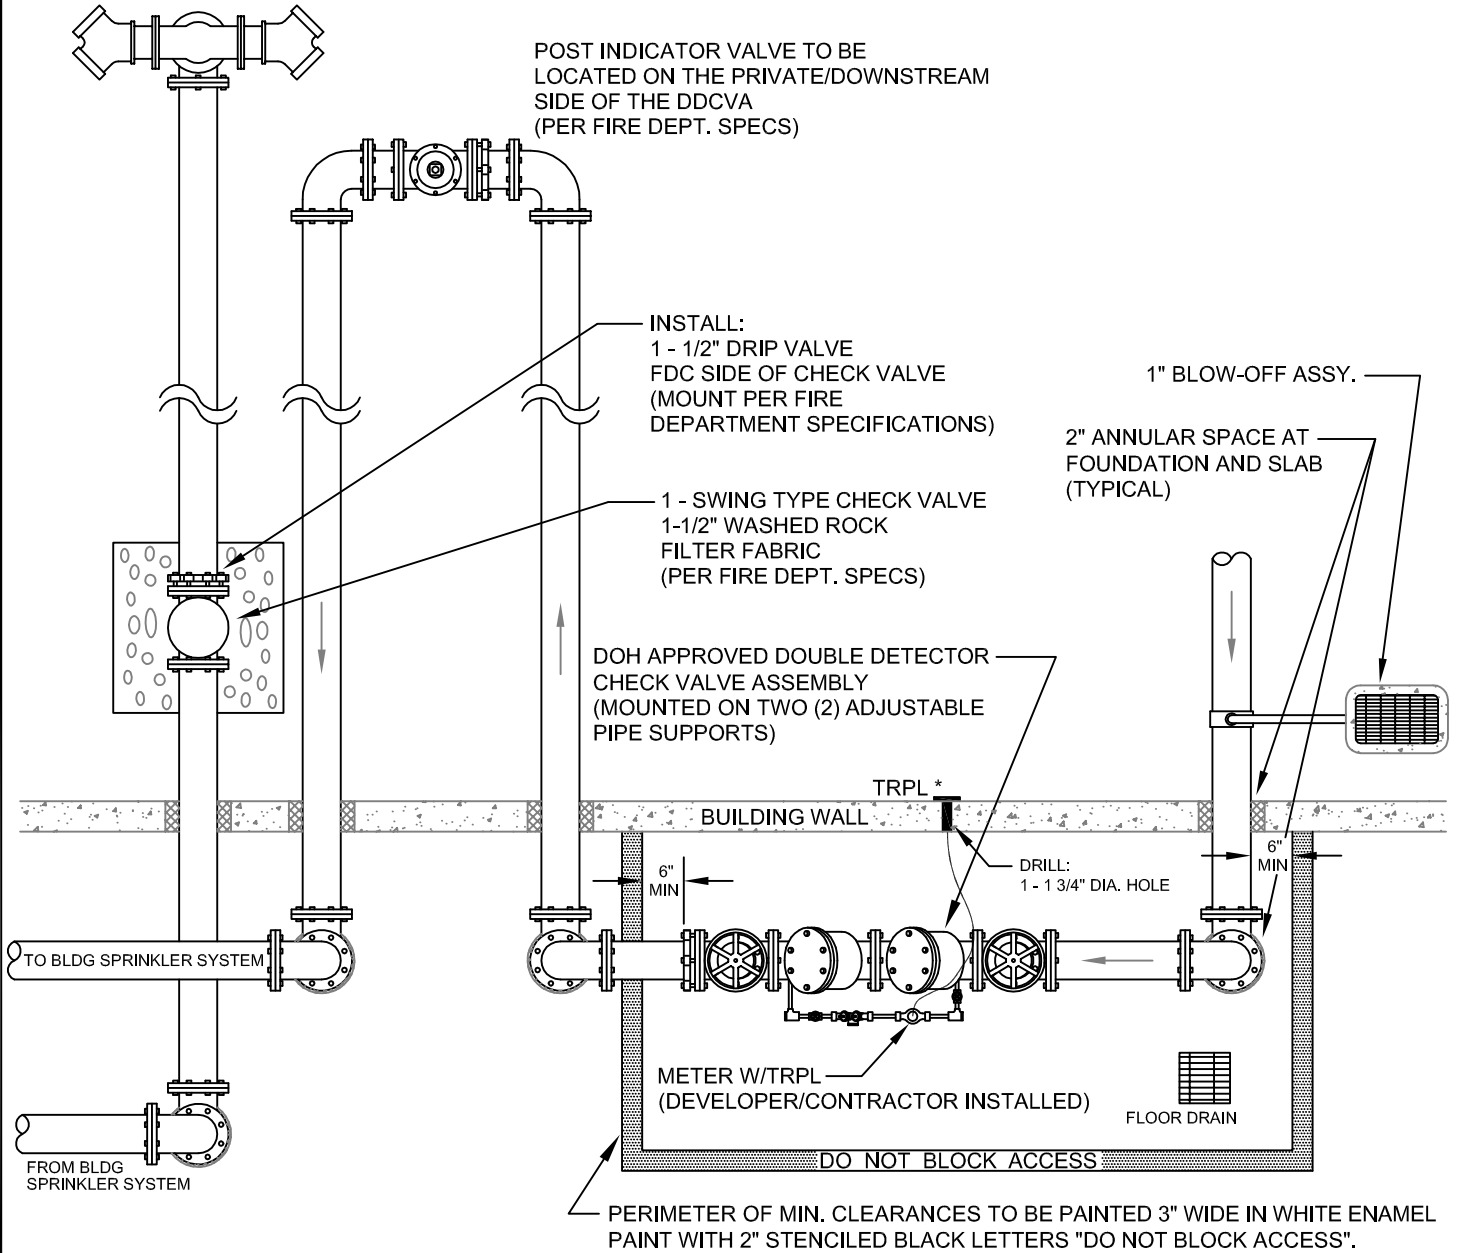

* NOTES: ALL DDCVA'S SHALL HAVE TOUCH-READ (TRPL) UNITS INSTALLED BY DEVELOPER/CONTRACTOR.
INSTALL LOCKING VALVE BOX LID FOR VALVE CONTROLLING SUPPLY LINE TO DDCVA.
OUTSIDE ACCESS DOOR TO FIRE DEVICE MUST BE PROVIDED.
BYPASS METER SHALL BE 5/8" X 3/4" SENSUS SR-II MODEL WITH ELECTRONIC REGISTER & PLUG-IN CONNECTORS.

* PROVIDE DOOR FOR DIRECT ENTRY FROM OUTSIDE OF BUILDING. *

**DOUBLE DETECTOR CHECK VALVE ASSY.
INSIDE BUILDING W / PIV & FDC**

NTS



REVISION DATE
10/19/07

DRAWN
SED

CHECKED
TDK

DISTRICT APPROVED
TDK

PLOTTING SCALE
NTS

FILE NAME
F:\DWGS\DETAILS-2004\HWD-035

DATE APPROVED
10/19/07