


- 2 - 1/4" X 2" BRASS NIPPLES
- 2 - 1/4" X 3/4" BRASS BUSHINGS
- 2 - 3/4" BRASS ELBOWS (FIP X COMP)
- ±5 LF 3/4" COPPER TUBING (TYPE K)
- 5 - 3/4" ADAPTORS (COMP X MIP)
- 1 - 3/4" 180° RETURN BEND (MIP)(GALV)
- 1 - 3/4" BRASS TEE (FIP)
- (CONNECT BLEEDER TO BOTH DRAINS
- 1 - 3/4" X 18" GALV. NIPPLE
- 1 - 3/4" BRASS COUPLING (FIP)

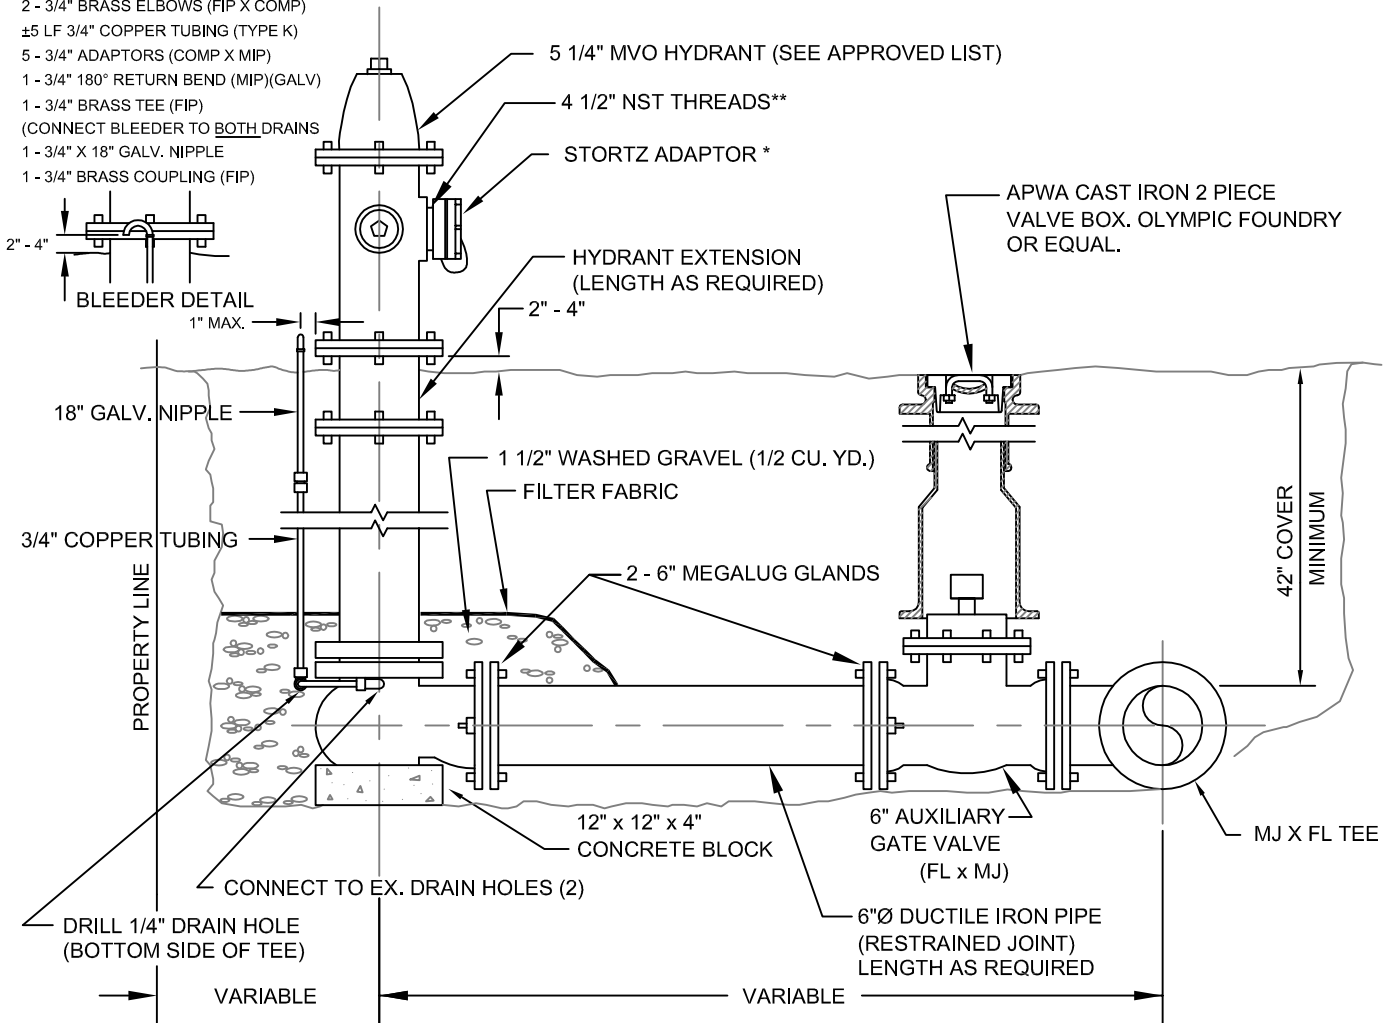

NOTES:

PAINT HYDRANT WITH CASE YELLOW #X3472 AS MANUFACTURED BY FARWEST PAINT MFG. CO.

EXTRUDED CURBING. SEE DETAIL #10.

INSTALL BLUE PAVEMENT MARKER IF HYDRANT IS IN RIGHT-OF-WAY.

NEATLY STENCIL VALVE DISTANCE ONTO HYDRANT W/ 2" NUMERALS USING WHITE OR BLACK ENAMEL PAINT AND FACING THE FOOT VALVE.

BLEEDER KIT AVAILABLE FROM MOST SUPPLIERS.

*** PUMPER PORT REQUIREMENTS:**

- 5" STORTZ ADAPTOR - FIRE DISTRICT #2, SOUTH KING, CITIES OF SEATAC & TUKWILA
- 4 1/2" NST THREADS FOR CITY OF KENT

HWD APPROVED HYDRANTS:

- CLOW MEDALLION F-2545
- MUELLER CENTURION A-423
- M & H RELIANT STYLE 929

**** ALL STORTZ ADAPTORS TO FIT 4 1/2" NST THREADS**

HYDRANT INSTALLATION

NTS

REVISION DATE 10/15/07	DRAWN SED	CHECKED TDK	DISTRICT APPROVED TDK
PLOTTING SCALE NTS	FILE NAME F:\DWGS\DETAILS-2004\HWD-009	DATE APPROVED 10/15/07	

